

2011

202

203

FLORIDES

~~NOTE~~

ON THIS SHEET BUILDINGS ARE SHOWN IN OUTLINE ONLY,
DETAILS OF PORCHES, BAY-WINDOWS, ETC., NOT BEING INCLUDED
MAXIMUM DIMENSIONS OF BUILDINGS AND DISTANCES BETWEEN
BUILDINGS RE TO SCALE

WATER FACILITIES

term. 1 concrete reservoir, capacity 50,000 gallons. 1 steel water tank, elevated 125' on steel frame, capacity 50,000 gallons. 1 Worthington centrifugal fire pump, capacity 750 gallons per minute, powered by Continental gasoline engine. 1 Worthington electric centrifugal service pump, capacity 150 gallons per minute. 4 1/2 miles of 4" to 8" water mains. 39 double hydrants. Average daily consumption 50,000 gallons. Domestic pressure 60 lbs; fire pressure 90 lbs.

FIRE DEPARTMENT

1 hose wagon with 1,000' 2½" hose pulled by one ton Chevrolet truck. Alarm by telephone. Also a privately owned siren at garage, corner Monroe and Lafitte Sts
No Fire Limits.


NO FIRE-RESISTIVE ROOFING ORDINANCE.



SURVEYED BY:

THE LOUISIANA FIRE PREVENTION BUREAU.

SCALE 1200 FT TO AN INCH

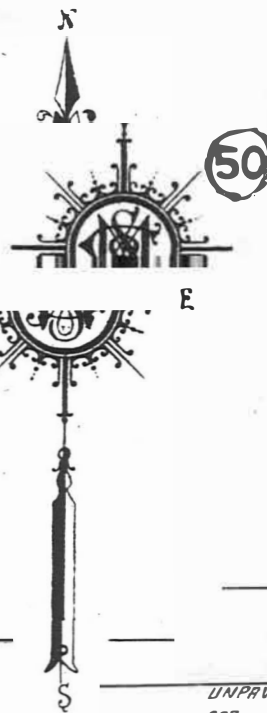

MONTGOMERY

Lake Pontchartrain

INDEX

[illegible]

VILLERE

MARIGNY

AV.)

Lamar UE

11

LIVINGSTON

810
MONROE

Scale 100 Ft to One Inch

Copyright 1926 by the Sanborn Map Co

4